

CERTIFICATE OF INVESTIGATION STUDY

STUDY OF VALIDATION OF THE EFFICIENCY OF HAIER AIR CONDITIONER ON SARS-COV-2 BY NO GLP VIRAL CLEARANCE STUDY (FIO)

Study number: **1198/02**

Study report for:

Sponsor: Qingdao Haier Air Conditioner General Co ., LTD

#1, Haier Road
Haier High-tech Industrial Park, Laoshan District
Qingdao City, Shandong Province
China

Submitted by:

Test Facility: TEXCELL
Test facility management: Boisson Bruno

Signature:
Genavenir 5
1 rue Pierre Fontaine
91058 Evry cedex
France



In Haier conditions of use:

**An inactivation and reduction titer of more 4.08 Log (99.991%) of Sars-Cov-2 in
24 hours was demonstrated on the device in 6.7m³ test lab.**

Texcell

Immeuble Genavenir 5

1 rue Pierre Fontaine

F-91058 EVRY Cedex

Téléphone : + 33 (0)1 60 91 33 10

Télécopie : + 33(0)1 64 93 33 24

www.texcell.com

CONTENT

1. PERSONNEL INVOLVED IN THE PROJECT	3
2. MATERIAL AND METHODS	3
2.1. Viruses (spiking test system)	3
2.2. Cells (titration test system)	4
2.3. Medium	5
3. EXPERIMENTS	5
3.1. Process Design	5
4. INFECTIVITY METHODS	6
4.1. Titration assay	6
4.2. Acceptance criteria of the titration assay	9
4.3. Determination of the viral titer	9
5. REDUCTION FACTOR CALCULATION	12
6. TABLES OF RESULTS	15
CONCLUSIONS	24

1. PERSONNEL INVOLVED IN THE PROJECT

From Texcell



Bruno BOISSON
Test Facility Management

29 MARS 2022

Date of signature

Virology and Titration Group:

Franck Gaston
Luck TY

2. MATERIAL AND METHODS

2.1. VIRUSES (SPIKING TEST SYSTEM)

- **Severe Acute Respiratory Syndrome-Related Coronavirus 2 (SARS-CoV-2):** (Istituto Nazionale malattie infettive (INMI) “Lazzaro Spallanzani”)

The human strain of SARS-COV-2 was obtained from a viral strain isolated in Italy at Istituto Nazionale malattie infettive (INMI) from a sample collected on January 29, 2020. The virus identity has been confirmed by complete sequencing. The complete sequence was submitted to GenBank (SARS-Cov-2/INMI1-Isolate/2020/Italy: MT066156) and is available on the GISAID website (BetaVov/Italy/INMI1-isl/2020: EPI_ISL_410545) upon registration. 2019-nCoV/Italy-INMI1 strain was used as a virus source and propagated on vero cells as described in the journal articles listed below:

Capobianchi MR, Rueca M, Messina F, Giombini E, Carletti F, Colavita F, Castilletti C, Lalle E, Bordi L, Vairo F, Nicastrì E, Ippolito G, Gruber CEM, Bartolini B. Molecular characterization of SARS-CoV-2 from the first case of COVID-19 in Italy. Clin Microbiol Infect. 2020 Jul;26(7):954-956. doi: 10.1016/j.cmi.2020.03.025.

Corman VM, Landt O, Kaiser M, Molenkamp R, Meijer A, Chu DKW, Bleicker T, Brünink S, Schneider J, Schmidt ML, Mulders DGJC, Haagmans BL, van der Veer B, van den Brink S, Wijsman L, Goderski G, Romette JL, Ellis J, Zambon M, Peiris M, Goossens H, Reusken C, Koopmans MPG, Drosten C. Detection of 2019 novel coronavirus (2019-nCoV) by real-time RT-PCR. Euro Surveill. 2020 Jan;25(3). doi: 10.2807/1560-7917.ES.2020.25.3.2000045.

Ogando NS, Dalebout TJ, Zevenhoven-Dobbe JC, Limpens RWAL, van der Meer Y, Caly L, Druce J, de Vries JJC, Kikkert M, Bárcena M, Sidorov I, Snijder EJ. SARS-coronavirus-2 replication in Vero E6 cells: replication kinetics, rapid adaptation and cytopathology. J Gen Virol. 2020 Jun 22. doi: 10.1099/jgv.0.001453.

Park WB, Kwon NJ, Choi SJ, Kang CK, Choe PG, Kim JY, Yun J, Lee GW, Seong MW, Kim NJ, Seo JS, Oh MD. Virus Isolation from the First Patient with SARS-CoV-2 in Korea. J Korean Med Sci. 2020 Feb 24;35(7):e84. doi: 10.3346/jkms.2020.35.e84.

Chu H, Chan JF, Yuen TT, Shuai H, Yuan S, Wang Y, Hu B, Yip CC, Tsang JO, Huang X, Chai Y, Yang D, Hou Y, Chik KK, Zhang X, Fung AY, Tsoi HW, Cai JP, Chan WM, Ip JD, Chu AW, Zhou J, Lung DC, Kok KH, To KK, Tsang OT, Chan KH, Yuen KY. Comparative tropism, replication kinetics, and cell damage profiling of SARS-CoV-2 and SARS-CoV with implications for clinical manifestations, transmissibility, and laboratory studies of COVID-19: an observational study. Lancet Microbe. 2020 May;1(1):e14-e23. doi: 10.1016/S2666-5247(20)30004-5.

2.1.1. Virus stock

Main characteristics of Sars-Cov-2 virus are described in the table below:

Virus	SARS-COV-2
Name	Severe Acute Respiratory Syndrome-Related Coronavirus 2
Family	Coronaviridae
Subfamily / Genus	Orthocoronavirus
Size in diameter	90-110 nm
Genome	One molecule of single-stranded RNA
Envelope	Enveloped
Strain	2019-nCoV/Italy-INMI1 strain
Production standard operating procedure (SOP)	TE1129
Titer of the virus stock used for spiking experiments	$\geq 6 \text{ Log}_{10} \text{ TCID}_{50}/\text{mL}$ (50 % tissue culture infective dose per milliliter)
Titration assay and cells	Virus titer is determined by end-point dilution titration assay on Vero cells (operating procedure TE1088).

2.2. CELLS (TITRATION TEST SYSTEM)

(Freshney R.I., 1989, ATCC)

The cells are grown in accordance with Texcell's operating procedures **TE1002**, **TE3001** and **TE3011**.

- **Vero cells:** (Institut Pasteur, Medical Virology Laboratory) (Simizu B. and Terasima T. 1988; Simizu B. et al., 1967).

Isolated from *C. aethiops* kidney on 27 Mar 1962. Vero cells are a lineage of [cells](#) used in [cell cultures](#). The 'Vero' lineage was isolated from [kidney epithelial](#) cells extracted from an [African green monkey](#) (*Chlorocebus* sp.; formerly called *Cercopithecus aethiops*, this group of monkeys has been split into several different species). The lineage was developed on 27 March 1962, by Yasumura and Kawakita at the [Chiba University](#) in [Chiba, Japan](#). The original cell line was named "[Vero](#)" after an [abbreviation](#) of [verda reno](#), which means "green kidney" in [Esperanto](#).

This is a cell line with the hypodiploid chromosome count. The modal chromosome number was 58 occurring in 66% of cells. In most cells, over 50% of the chromosomes in each cell complement belonged to structurally altered marker chromosomes. Normal A3, A4, B4, and B5 were absent; B2, B3 and B7 were occasionally paired; and B9, C1 and C5 were mostly paired. The rate of cells with higher ploidies was 1.7%. Other chromosomes were

mostly present in single copy. These cell lines from ATCC (CCL-81, CRL-1587, CRL1586), are used for the propagation, assay and isolation of numerous viruses like coronaviruses. This line is a clone from Vero 76. Vero E6 cells are known to show some contact inhibition, and are often suitable for propagating viruses that replicate slowly and was therefore used to isolate the strain of SARS-COV-2 virus used in this study. Virucidity assays are performed using either the Vero cell line from ATCC CCL-81 or from Institut Pasteur (IP)

2.3. MEDIUM

Vero cells:

Dilution medium: DMEM 2% glutamine, 1% gentamicine

Cell Culture medium: DMEM 4% SVF, 2% glutamine, 1% gentamicine

Titration medium: DMEM 2% glutamine, 1% gentamicine

3. EXPERIMENTS

3.1. PROCESS DESIGN

As requested by the sponsor the process below will be evaluated as one step :

As requested by the sponsor the process below will be evaluated as one step:

Haier device

(A) Inactivation

- Virus gauze preparation with SARS-COV-2
- Place virus 2 gauze and Haier device into a workhouse (1 gauze on the device and 1 gauze at 1 meter in front of the DIU for horizontal position, adjust its height to 1.5 meters high)
- After the required incubation time (24h, 4h, 1h) the virus gauze is removed
- virus gauze in the test group and control group was eluted thoroughly with 10ml eluent, respectively
- Virus titration and calculation virus reduction factor R
Process Duration (X) = 24h, 4h and 1h

Titration:

Virus titration will be performed by end-point dilution assay (TCID₅₀) for SARS-COV-2.

Samples obtained during the spiking experiments will be titrated immediately with the appropriate controls (depending of the Preliminary Assay result).

4. INFECTIVITY METHODS

4.1. TITRATION ASSAY

The samples are titrated according to operating procedure **TE1088**.

4.1.1. Principle of titration

The titration method is a quantitative assay in which the virus titer measurement is based on the detection of virus production in the infected cells, by observation of a specific cytopathic effect.

***Serial dilutions titration**

Briefly:

Test sample is diluted with medium by serial 3-fold dilutions (eight replicates are performed for each dilution) across the 96 well plate (sample dilution plate).

Each well from the “sample dilution plate” is then inoculated on the corresponding well of a new plate (sample titration plate).

Cell suspension is added to each well of the “sample titration plate” and the plates are then incubated at appropriate temperature with or without CO₂ atmosphere (depending on viruses).

After a period of incubation allowing viral replication and infection of adjacent cells, depending on viruses,

- wells with foci are counted after infection by observation under inverted light microscope.
- or a stain overlay (crystal violet) is added and wells are examined for cytopathic effect. The infected wells show up as clear areas whereas the non-infected wells are stained.

The infectious titer expressed as 50% tissue culture infective dose per milliliter (TCID₅₀/mL) is calculated using the Spearman-Kärber formula.

***Large Volume titration (LVT)**

LVT assay could be performed (at the sponsor request) in order to improve the detection limit of the assay or the titer of the tested sample. Cells in 96 well plates or flasks (number according to desired sensitivity) are inoculated with a large volume of the lowest non-toxic and non-interfering dilution of the sample.

Cell suspension is then added to each well of the “sample titration plate” and the plates are incubated at appropriate temperature with or without CO₂ atmosphere (depending on viruses).

After a period of incubation allowing viral replication and infection of adjacent cells, depending on viruses,

- wells with foci are counted after infection by observation under inverted light microscope.
- or a stain overlay (crystal violet) is added and wells are examined for cytopathic effect. The infected wells show up as clear areas whereas the non-infected wells are stained.

The infectious titer expressed as 50% tissue culture infective dose per milliliter (TCID₅₀/mL) is calculated using the appropriate formula.

4.1.2. Titration assay controls

***Negative control N1 (cell reference control)**

During titration assay, in each 96-well plate, 8 wells are prepared as cell reference control. These cells are prepared in the same conditions as those used for the titration of the samples generated during the viral clearance experiments except that they are inoculated with unspiked medium.

***Positive reference control (virus reference control)**

During each titration assay, a stock of each virus prepared at low final concentration of approximately $10^5 - 10^7$ TCID₅₀/mL (depending on virus) and used as virus reference control is titrated in the same conditions as those used for the titration of the samples generated during experiments.

4.1.3. Spiking experiments controls***Cytotoxicity test control(s)**

The evaluation of the cytotoxic effect is carried out by visual observation under inverted light microscope. The quality of the cell monolayer (confluence, refringence, aspect) of the tested samples is compared with that of the cell reference control N1.

Negative controls (N2 and N3) and each dilution of samples for which no total cytopathic effect is observed are evaluated for cytotoxicity by comparison with the cell reference control N1. Similar serial dilutions as those used for the titration assays are applied.

For a defined sample, the non-cytotoxic dilution is reached when no significant difference is observed in the 3-fold serial diluted sample compared with the cell reference control.

***Storage control(s)**

The evaluation of the effect of the storage conditions on virus in the tested sample during the storage at $\leq -70^\circ\text{C}$ is carried out by comparison of the titers obtained in medium and in diluted sample after storage.

This evaluation is carried out with the starting material(s), and/or the final material(s) obtained from the Mock run when the generated samples are stored until titration.

The study is described as follows:

- The starting material and/or the final material is diluted at a defined dilution, and then spiked with virus (positive control or virus stock) at a low final concentration of approximately $10^3 - 10^4$ TCID₅₀/mL.
- In parallel, medium is also spiked with the same virus (positive control or virus stock) to reach the same concentration as the starting material and/or final material samples.

Both storage controls samples are then stored at $\leq -70^\circ\text{C}$ until titration. These storage controls are prepared and titrated with the experiments generated samples

After titration, there is no storage effect on virus, when the difference between the two titers (titer in medium compared with titer in starting and/or final material(s)) is less than or equal to 1Log_{10} .

***Viral interference assay(s)**

The evaluation of the potential interference of the lowest non-cytotoxic dilution of the sample on virus during the incubation period is carried out by comparison of the results obtained during the titration of the virus stock with medium, and the virus stock with diluted sample (final material/starting material and/or intermediate product).

The evaluation is carried out with the final material(s) (obtained from the mock run).

The results are used for the calculation of the reduction factor of the step.

The study of sample interference on virus titration is described as follows:

- First, the virus reference control (titration reference) at a low final concentration of approximately 10^5 - 10^7 TCID₅₀/mL, is titrated in the usual conditions i.e. serial 3-fold dilutions using medium as diluting medium
- In parallel, the same virus reference control is titrated by serial 3-fold dilutions using the lowest non-cytotoxic dilution of the sample to be tested as diluting medium.

The evaluation of the potential interference of the lowest non-cytotoxic dilution of the sample with the virus during the incubation period is carried out by comparison of the titers obtained in medium versus titers obtained in diluted sample.

For the defined non-cytotoxic dilution of the sample, there is no interference when the difference between the two titers is less than or equal to 1Log_{10} . This non-cytotoxic and non-interfering dilution is then used for the calculation of the infectious titer of the sample.

4.2. ACCEPTANCE CRITERIA OF THE TITRATION ASSAY

During each titration assay, a virus stock prepared at low final concentration of approximately $10^5 - 10^7$ TCID₅₀/mL (depending on virus), is used as reference control.

The titration assay is retained when:

- the cell reference control (N1) for each titration plate is conform to the expected result,
- the infectious titer of the virus reference control obtained is in the expected range.

4.3. DETERMINATION OF THE VIRAL TITER

(Schwartz D., 1993; Kaplan M. and Koprowski H., 1973)

Three situations may be predicted concerning the calculation of the viral titer.

Case	Subcase	Titer (T)
Infectious particles detected ≥ 12.5% positive wells/total tested wells		$T = T_{SK}$
Few infectious particles detected < 12.5% positive wells/total tested wells	$T_{MaxL} > dl$	$T = T_{MaxL}$
	$dl > T_{MaxL}$	$T = dl$
No infectious particles detected 0% positive well/total tested wells		$T < dl$

with:

- T = titer retained for the calculation of the reduction factor
- T_{SK} = infectious titer using the simplified Spearman-Kärber formula (Section 2.3.1)
- T_{MaxL} = infectious titer using the Maximum likelihood estimation (Section 2.3.2)
- dl = detection limit using the Poisson formula with 95% precision (Section 2.3.3)

4.3.1. Calculation of the TCID₅₀ using Spearman-Kärber formula

The TCID₅₀ is evaluated by quantitative assay and defined as the virus dose capable of infecting 50% of the inoculated cultures.

The viral titer, T, expressed as the 50% tissue culture infective dose per milliliter (TCID₅₀/mL), is defined by its mean value, m(T), and its confidence interval.

m(T) can be calculated according to the following formula:

$$m(T) = \frac{1}{V_0} 10^{m(a)}$$

with v_0 = volume per replicate

"a" is also defined by its mean, m(a), and its standard deviation, S(a).

The viral titer can be calculated using Spearman-Kärber (SK) formula (Payment P. and Trudel M. 1993).

*This method is applicable firstly, in situations where cytopathic effect is observed, ranging from 0% to 100% of positive replicas per dilution in a same titration plate.

m(a) = T_{SK} , and S(a) is calculated using the following simplified Spearman-Kärber formula

$$m(a) = T_{SK} = -a_0 + \frac{k}{2} - k \sum_i p_i \quad \text{and} \quad S(a)^2 = k^2 \sum_i \frac{p_i (1 - p_i)}{n_i - 1}$$

with:

- a = Log_{10} of the titer relative to the test volume
- a_0 = Log_{10} of the reciprocal of the lowest dilution for which all wells are positive
- k = Log_{10} of the dilution factor
- p_i = proportion of positive wells at the non-cytotoxic dilution d_i / r_i
- r_i = number of positive wells at the non-cytotoxic dilution d_i
- n_i = number of replicates at the non-cytotoxic dilution d_i .

With a 95% precision, the confidence interval of "a" is the following:

$$a^{\min} \leq a \leq a^{\max} \quad \text{with:} \quad a^{\min} = m(a) - 2 S(a)$$

$$a^{\max} = m(a) + 2 S(a)$$

With a 95% precision, the confidence interval of the titer T is the following:

$$T^{\min} \leq T \leq T^{\max} \quad \text{with:}$$

$$T^{\min} = \frac{1}{V_0} 10^{a^{\min}}; \quad T^{\max} = \frac{1}{V_0} 10^{a^{\max}}$$

The dilutions of the samples retained for the calculation of the infectious titers are those for which no cytotoxicity is observed.

*Secondly, when less than 100% but $\geq 12.5\%$ of positive replicas per dilution is obtained for the lowest non-cytotoxic dilution tested, the virus titer is calculated assuming that the sample contains sufficient virus to infect 100% of tested wells at the previous serial dilution (worst-case).

*Total virus load

The viral load L is defined by its mean value, $m(L)$, and its confidence interval.

$$m(L) = \frac{m(T)V_t}{c}$$

$$L^{\min} \leq L \leq L^{\max}: \quad L^{\min} = \frac{T^{\min}V_t}{c} \quad \text{and} \quad L^{\max} = \frac{T^{\max}V_t}{c}$$

with:

- c = concentration factor of the ultracentrifugation (c = 1 when the samples are not ultracentrifuged).
- V_t = total volume of the sample during the scaled down process.

4.3.2. Large Volume Titration assay: Maximum Likelihood estimation

During LVT assay, when few positive wells are detected (< 12.5% of all tested wells), viral titers (T_{MaxL}) in samples are calculated according to Maximum Likelihood estimation (Agut H., Calvez V., Barin F, 1997) as follows:

$$T_{MaxL} = (\ln(N/P) \times d \times (1000/v)) / \ln 2$$

with:

T_{MaxL} = titer relative to the test volume (TCID₅₀/mL)

N = number of all tested wells

P = number of negative wells

d = non-cytotoxic dilution factor of the sample

v = tested volume per well

$\ln 2 \approx 0.69$ = corrective factor to convert PFU/mL into TCID₅₀/mL.

When significant positive wells are detected (>12.5% of all tested wells) viral titers (T_{MaxL}) in samples are calculated using the Spearman-Kärber formula as described above.

***Total virus load**

The viral load L is defined by its mean value, $m(L_{MaxL})$.

$$m(L_{MaxL}) = \frac{m(T_{MaxL})V_t}{c}$$

with:

c = concentration factor of the ultracentrifugation (c = 1 when the samples are not ultracentrifuged).

V_t = total volume of the sample during the scaled down process.

4.3.3. Detection limit of titration assay

When a sample contains a low concentration of infectious virus and only a fraction of the sample is tested for titration, there is a probability that the result of the tested fraction will be negative due to random (and unequal) distribution of the virus throughout the sample.

The detection limit, **dl**, for the titration assay corresponds to the lower theoretical titer which results in the detection of one infectious particle in one of the replicates performed. Since the infectious particle would be detected in a volume V_c (mL) of the dilution d_c , the detection limit, **dl**, is calculated with a 95% precision according to the Poisson formula (Löwer J., 1991):

$$p(95\%) = e^{-dl} [V_c d_c] = 0.05$$

$$\text{i.e.} \quad dl = \frac{-\ln(0.05)}{V_c d_c}$$

with:

$V_c = [v_o n_c]$

v_o = volume per replicate

n_c = number of replicates at non-cytotoxic dilution d_c

dl = detection limit

The non-cytotoxic dilution of the samples for which no positive wells are detected is then retained for the calculation of the infectious titer using the Poisson formula.

The infectious titers calculated with the Poisson formula are expressed as PFU/mL and are divided by $\ln 2$ to be converted into TCID₅₀/mL.

***Detection limit of the viral load of a whole fraction**

The detection limit, DL, is the minimal viral load which could be theoretically detected in the total volume of a fraction belonging to the scaled down process.

DL is calculated according to the following formula:

$$DL = \frac{dl V_t}{c}$$

with:

- c = concentration factor of the ultracentrifugation (c = 1 when the samples are not ultracentrifuged),
- V_t = total volume of the sample during the scaled down process,
- dl = detection limit for a titration assay.

The detection limit for the pre and post-treatment material are DL_i and DL_f respectively.

5. REDUCTION FACTOR CALCULATION

In accordance with the regulatory documents, the virus reduction factor (R) of an individual purification or inactivation step is defined as the Log₁₀ of the ratio of the virus load (L_i) in the pre-treatment material (starting material) and the virus load (L_f) in the post-treatment material (final material) which is ready for use in the next step of the process.

R is defined by its mean, m(R), and its confidence interval, [R_{min} ≤ R ≤ R_{max}]. If R_{min} and/or R_{max} is < 0 (negative value), then m(R) will present as ≈ 0 without confidence interval.

Different cases have to be considered related to the effect of the pre-treatment material on the virus.

***Case 1**

A studied manufacturing process step consists in the monitoring of a viral inactivation directly linked to a solution used during the process ("in process fraction", sanitization solution, etc.). In other terms, a putative virucidal effect associated with a solution is evaluated in a kinetics study.

***Case 2: Treatment reduction factor calculation $m(R_t)$**

The pre-treatment material has **no significant inactivating effect**, i.e. the mean reduction factor, **$m(R_o)$ is lower than or equal to 1**. $m(R_o)$ is defined as the Log_{10} of the ratio of the virus load in the medium (L_{cm}) and the virus load in the pre-treatment material (L_i).

In this case, the reduction factor of the step corresponds to the reduction factor of the treatment $m(R_t)$.

***Case 3: Clearance factor calculation $m(R)$**

The pre-treatment material has **a significant inactivating effect** (excluding Case 1) i.e. the mean reduction factor, **$m(R_o)$ is higher than 1**.

- In a first approach, the clearance factor of the step, $m(R)$, is calculated as the sum of the reduction factor associated with the initial inactivating effect, $m(R_o)$, and the reduction factor of the treatment, $m(R_t)$. The initial load is the virus load in medium (L_{cm}).
- In a second approach, the reduction factor of the treatment, $m(R_t)$ is calculated with the virus load in the pre-treatment material (L_i).

In practice,

- if the volume of post-treatment material (V_f) = volume of pre-treatment material (V_i) \pm 5% (v/v), the reduction and clearance factors are calculated with viral titers and then $X = T$.
- Otherwise, the reduction and clearance factors are calculated with viral loads and then $X = L$.

CASES	SUBCASES	EVALUATION OF THE REDUCTION FACTOR R_t AND CLEARANCE FACTOR (R)
Case 1		R is evaluated according to the three subcases of Case 2, with $X_i = X_{cm}$
Case 2 $m(R_o) \leq 1$	$m(x_f) < DL_f$	$R_t > \text{Log}_{10} \left(\frac{m(X_i)}{DL_f} \right)$ with $R_{min} \leq R_t \leq R_{max}$
	$X_i^{min} \geq X_f^{max}$	$m(R_t) = \text{Log}_{10} \left(\frac{m(X_i)}{m(X_f)} \right)$ with $R_{min} \leq R_t \leq R_{max}$
	$X_i^{min} < X_f^{max}$	$m(R_t)$ is calculated according to subcase 2 $R_t \approx 0$ if R_{min}, R_t or $R_{max} < 0$ (negative value)
Case 3 $m(R_o) \geq 1$	$m(X_i) < DL_i$	R_t cannot be evaluated $R_o \geq \text{Log} \left(\frac{m(X_{cm})}{DL_i} \right)$ with $R_{min} \leq R_o \leq R_{max}$
	$m(X_i) \geq DL_i$	R_t can be evaluated at sponsor request, otherwise $R = R_t + R_o$ is calculated R is evaluated according to the three subcases of Case 2 with $X_i = X_{cm}$ $m(R_o) = \text{Log}_{10} \left(\frac{m(X_{cm})}{m(X_i)} \right)$ with $R_{min} \leq R_o \leq R_{max}$

X_i = initial sample titre (Ti) or load (Li)

X_f = final sample titre (Tf) or load (Lf)

X_{cm} = culture medium titre (Tcm) or load (Lcm)

$m(X)$ = mean titre or load

$R_{min} = R - 2 \sqrt{\text{var } Ti + \text{var } Tf}$

$R_{max} = R + 2 \sqrt{\text{var } Ti + \text{var } Tf}$

$$\text{Var} = \text{Variance} = S(a)^2 = k^2 \sum_i \frac{p_i(1-p_i)}{n_i-1}$$

with:

- k = Log of the dilution factor
- p = proportion of positive wells at the non-cytotoxic dilution d / r
- r = number of positive wells at the non-cytotoxic dilution d
- n = number of replicates at the non-cytotoxic dilution d.

6. TABLES OF RESULTS

Table 1 : STUDY OF EVALUATION OF THE EFFICIENCY OF HAIER AIR CONDITIONER (1H) ON THE SARS-COV2 BY NO GLP VIRAL CLEARANCE STUDY (FIO)

TABLE 1.1: CONTROLS					
Sample		Infectious Titer (T)		Reduction factor evaluation (R)	
code	Definition	code	Mean titer [m(T)] and confidence interval	Mean reduction factor m(R) and confidence interval	Definition
Negative controls					
Positive controls					
V1	Spiked (addition of virus stock) medium	TV1	5.24 5.00 ≤ T ≤ 5.48	NA	Virus stock control before process
V2	Spiked (addition of virus stock) medium	TV2	5.24 5.00 ≤ T ≤ 5.48	NA	Virus stock control after 1 hour (old control)
L1	Spiked (addition of virus stock) gauze and recovery	TL1	5.00 5.80 ≤ T ≤ 6.11	NA	Virus stock recovery control before process
L2	Spiked (addition of virus stock) gauze and recovery	TL2	4.04 3.81 ≤ T ≤ 4.28	NA	Virus stock recovery control after 1 hour (old control)

Infectious titers are expressed as Log₁₀ 50% tissue culture infectious dose per milliliter (Log₁₀ TCID₅₀/mL).

Table 1 (continued): **STUDY OF EVALUATION OF THE EFFICIENCY OF HAIER AIR CONDITIONER (1H) ON THE SARS-COV2 BY NO GLP VIRAL CLEARANCE STUDY (FIO)**

TABLE 1.2: CONTROLS						
Sample		Infectious Titer (T)		Reduction factor evaluation (R)		
code	Definition	code	Mean titer [m(T)] and confidence interval	Mean reduction factor m(R) and confidence interval	Definition	Definition
Comparison of positive controls						
V1	Spiked (addition of virus stock) medium	TV1	5.24 $5.00 \leq T \leq 5.48$	NA	NA	Virus stock control
V2	Spiked (addition of virus stock) medium	TV2	5.24 $5.00 \leq T \leq 5.48$	~0	Not significant	Experiment effect on virus in hold control (comparison TV1 and TV2)
L1	Spiked (addition of virus stock) gauze and recovery	TL1	5.00 $5.80 \leq T \leq 6.11$	~0	Not significant	Experiment effect on virus in recovery gauze control (comparison TV1 and TL1)
L2	Spiked (addition of virus stock) gauze and recovery	TL2	4.04 $3.81 \leq T \leq 4.28$	= 0.95	Not significant	Experiment effect on virus in recovery gauze hold control (comparison TL1 and TL2)

Table 1 (continued): **STUDY OF EVALUATION OF THE EFFICIENCY OF HAIER AIR CONDITIONER (1H) ON THE SARS-COV2 BY NO GLP VIRAL CLEARANCE STUDY (FIO)**

TABLE 1.3: SPIKING EXPERIMENTS									
code	Sample definition	Vol (Vt) mL	Infectious Titer (T) code	Mean titer [m(T)] and confidence interval	Virus load (L) code	Mean load [m(L)]=m(T) x Vt]			
Reduction factor evaluation (R)									
Mean reduction factor m(R) and confidence interval [m(R)] = Log ₁₀ (L1) – Log ₁₀ (LS)									
Positive control									
L1	Spiked (addition of virus stock) gauze and recovery	1	TL1	5.00	5.80 ≤ T ≤ 6.11	LL1	5.00	5.80 ≤ T ≤ 6.11	Virus stock recovery gauze control
STUDY									
Samples collected, recovery and diluted: Clearance factor									
S1	Gauze on the evaporator, 10 centimeters away from the center of UVC module in horizontal position 1 hour	1	TS1	1.78	1.56 ≤ T ≤ 2.00	LS1	1.78	1.56 ≤ T ≤ 2.00	R = 3.22 (99.939%)
S2	Gauze at 1 meter in front of the DIU for horizontal position, adjust its height to 1.5 meters high 1 hour	1	TS2	4.52	4.22 ≤ T ≤ 4.82	LS2	1.16	NA (no virus)	R = 0.48 (66.886%)

Infectious titers are expressed as 50% tissue culture infectious dose per milliliter (Log₁₀ TCID₅₀/mL). Viral loads are expressed as 50% tissue culture infectious dose (Log₁₀ TCID₅₀).

Table 2: STUDY OF EVALUATION OF THE EFFICIENCY OF HAIER AIR CONDITIONER (4H) ON THE SARS-COV2 BY NO GLP VIRAL CLEARANCE STUDY (FIO)

TABLE 2.4: CONTROLS					
Sample		Infectious Titer (T)		Reduction factor evaluation (R)	
code	Definition	code	Mean titer [m(T)] and confidence interval	Mean reduction factor m(R) and confidence interval	Definition
Negative controls					
Positive controls					
V1	Spiked (addition of virus stock) medium	TV1	5.12 4.90 ≤ T ≤ 5.34	NA	Virus stock control before process
V2	Spiked (addition of virus stock) medium	TV2	4.76 4.60 ≤ T ≤ 4.92	NA	Virus stock control after 4 hours (old control)
L1	Spiked (addition of virus stock) gauze and recovery	TL1	5.24 5.08 ≤ T ≤ 5.15	NA	Virus stock recovery control before process
L2	Spiked (addition of virus stock) gauze and recovery	TL2	4.04 3.81 ≤ T ≤ 4.28	NA	Virus stock recovery control after 4 hours (old control)

Infectious titers are expressed as Log₁₀ 50% tissue culture infectious dose per milliliter (Log₁₀ TCID₅₀/mL).

Table 2 (continued): **STUDY OF EVALUATION OF THE EFFICIENCY OF HAIER AIR CONDITIONER S (4H) ON THE SARS-COV2 BY NO GLP VIRAL CLEARANCE STUDY (FIO)**

TABLE 2.5: CONTROLS						
Sample		Infectious Titer (I)		Reduction factor evaluation (R)		
code	Definition	code	Mean titer [m(T)] and confidence interval	Mean reduction factor m(R) and confidence interval	Reduction factor	Definition
Comparison of positive controls						
V1	Spiked (addition of virus stock) medium	TV1	5.12 4.90 ≤ T ≤ 5.34	NA	NA	Virus stock control
V2	Spiked (addition of virus stock) medium	TV2	4.76 4.60 ≤ T ≤ 4.92	= 0.36	Not significant	Experiment effect on virus in hold control (comparison TV1 and TV2)
L1	Spiked (addition of virus stock) gauze and recovery	TL1	5.24 5.08 ≤ T ≤ 5.15	~ 0	Not significant	Experiment effect on virus in recovery gauze control (comparison TV1 and TL1)
L2	Spiked (addition of virus stock) gauze and recovery	TL2	4.04 3.81 ≤ T ≤ 4.28	= 0.84	Not significant	Experiment effect on virus in recovery gauze hold control (comparison TL1 and TL2)

Table 2 (continued): **STUDY OF EVALUATION OF THE EFFICIENCY OF HAIER AIR CONDITIONER (4H) ON THE SARS-COV2 BY NO GLP VIRAL CLEARANCE STUDY (FIO)**

TABLE 2.6: SPIKING EXPERIMENTS						
Sample	Vol	Infectious Titer (T)		Virus load (L)		Reduction factor evaluation (R)
code	definition	code	Mean titer [m(T)] and confidence interval	code	Mean load [m(L)=m(T) x Vt]	Mean reduction factor m(R) and confidence interval [m(R)] = Log ₁₀ (L1) – Log ₁₀ (LS)
Positive control						
L1	Spiked (addition of virus stock) gauze and recovery	TL1	5.08 ≤ T ≤ 5.15	LL1	5.08 ≤ T ≤ 5.15	Virus stock recovery gauze control
STUDY						
Samples collected, recovery and diluted: Clearance factor						
S1	Gauze on the evaporator, 10 centimeters away from the center of UVC module in horizontal position 4 hours	TS1	1.54	LS1	1.54	R = 3.70 (99.980%)
S2	Gauze at 1 meter in front of the DIU for horizontal position, adjust its height to 1.5 meters high 4 hours	TS2	4.40	LS2	4.40	R = 0.83 (85.208%)

Infectious titers are expressed as 50% tissue culture infectious dose per milliliter (Log₁₀ TCID₅₀/mL). Viral loads are expressed as 50% tissue culture infectious dose (Log₁₀ TCID₅₀).

**STUDY OF EVALUATION OF THE EFFICIENCY OF HAIER AIR CONDITIONER (24H) ON THE SARS-COV2 BY
NO GLP VIRAL CLEARANCE STUDY (FIO)**

TABLE 3.7: CONTROLS

Sample		Infectious Titer (T)		Reduction factor evaluation (R)	
code	Definition	code	Mean titer [m(T)] and confidence interval	Mean reduction factor m(R) and confidence interval	Definition
Negative controls					
Positive controls					
V1	Spiked (addition of virus stock) medium	TV1	5.48 $5.32 \leq T \leq 5.63$	NA	Virus stock control before process
V2	Spiked (addition of virus stock) medium	TV2	4.40 $4.15 \leq T \leq 4.66$	NA	Virus stock control after 24 hours (old control)
L1	Spiked (addition of virus stock) gauze and recovery	TL1	5.24 $5.00 \leq T \leq 5.48$	NA	Virus stock recovery control before process
L2	Spiked (addition of virus stock) gauze and recovery	TL2	3.45 $3.16 \leq T \leq 3.73$	NA	Virus stock recovery control after 24 hours (old control)

Infectious titers are expressed as Log_{10} 50% tissue culture infectious dose per milliliter (Log_{10} TCID₅₀/mL).

Table 3 (continued): STUDY OF EVALUATION OF THE EFFICIENCY OF HAIER AIR CONDITIONER (24H) ON THE SARS-COV2 BY NO GLP VIRAL CLEARANCE STUDY (FIO)

TABLE 3.8: CONTROLS						
Sample		Infectious Titer (T)		Reduction factor evaluation (R)		
code	Definition	code	Mean titer [m(T)] and confidence interval	Mean reduction factor m(R) and confidence interval	Reduction factor	Definition
Comparison of positive controls						
V1	Spiked (addition of virus stock) medium	TV1	5.48 $5.32 \leq T \leq 5.63$	NA	NA	Virus stock control
V2	Spiked (addition of virus stock) medium	TV2	4.40 $4.15 \leq T \leq 4.66$	= 1.07	Significant	Experiment effect on virus in hold control (comparison TV1 and TV2)
L1	Spiked (addition of virus stock) gauze and recovery	TL1	5.24 $5.00 \leq T \leq 5.48$	= 0.24	Not significant	Experiment effect on virus in recovery gauze control (comparison TV1 and TL1)
L2	Spiked (addition of virus stock) gauze and recovery	TL2	3.45 $3.16 \leq T \leq 3.73$	= 1.79	Significant	Experiment effect on virus in recovery gauze hold control (comparison TL1 and TL2)

Table 3 (continued): **STUDY OF EVALUATION OF THE EFFICIENCY OF HAIER AIR CONDITIONER (24H) ON THE SARS-COV2 BY NO GLP VIRAL CLEARANCE STUDY (FIO)**

TABLE 3.9: SPIKING EXPERIMENTS							
code	Sample definition	Vol (Vt) mL	Infectious Titer (T)		Virus load (L)		Reduction factor evaluation (R) Mean reduction factor m(R) and confidence interval [m(R)] = $\text{Log}_{10}(\text{L1}) - \text{Log}_{10}(\text{LS})$
			code	Mean titer [m(T)] and confidence interval	code	Mean load [m(L)]=m(T) x Vt]	
Positive control							
L1	Spiked (addition of virus stock) gauze and recovery	1	TL1	5.24 $5.00 \leq T \leq 5.48$	LL1	5.24 $5.08 \leq T \leq 5.15$	Virus stock recovery gauze control
STUDY							
Samples collected, recovery and diluted: Clearance factor							
S1	Gauze on the evaporator, 10 centimeters away from the center of UVC module in horizontal position 24 hours	1	TS1	1.16 NA	LS1	1.16 NA (No virus)	$R > 4.08$ ($>99.991\%$)
S2	Gauze at 1 meter in front of the DIU for horizontal position, adjust its height to 1.5 meters high 24 hours	1	TS2	3.57 $3.27 \leq T \leq 3.87$	LS2	3.57 $3.27 \leq T \leq 3.87$	$R = 1.67$ (97.862%)


Infectious titers are expressed as 50% tissue culture infectious dose per milliliter ($\text{Log}_{10} \text{TCID}_{50}/\text{mL}$). Viral loads are expressed as 50% tissue culture infectious dose ($\text{Log}_{10} \text{TCID}_{50}$).

CONCLUSIONS


The resulted virus reduction factor (R) of the “Haier’s air conditioner” for the time tested in this study is more 99.991% (>4.08 log) with 1.67 log due to the experiments duration.

APPENDED

Cells without effect cytho pathogen

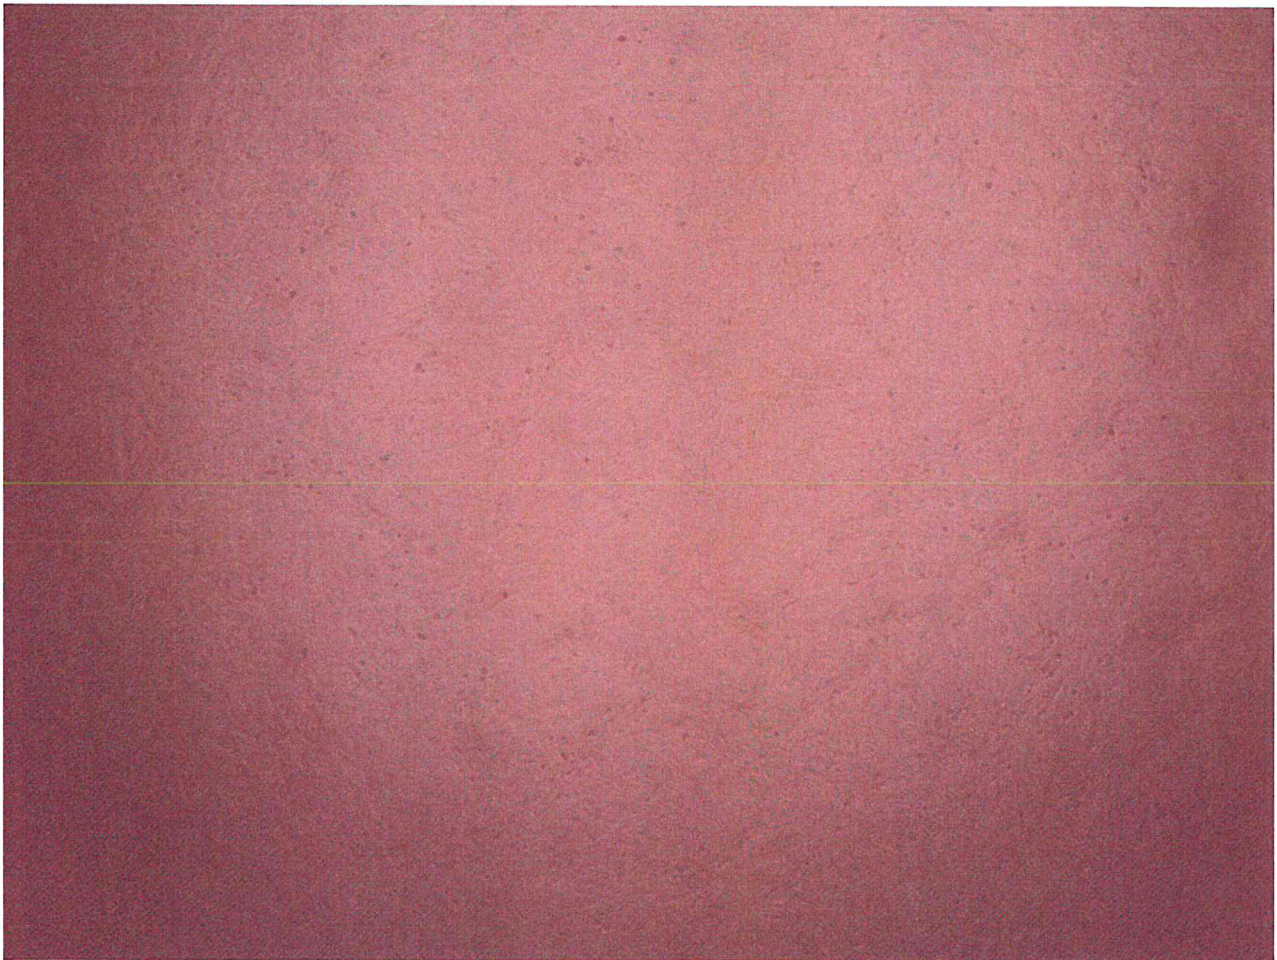


Cells with effect cytho pathogen

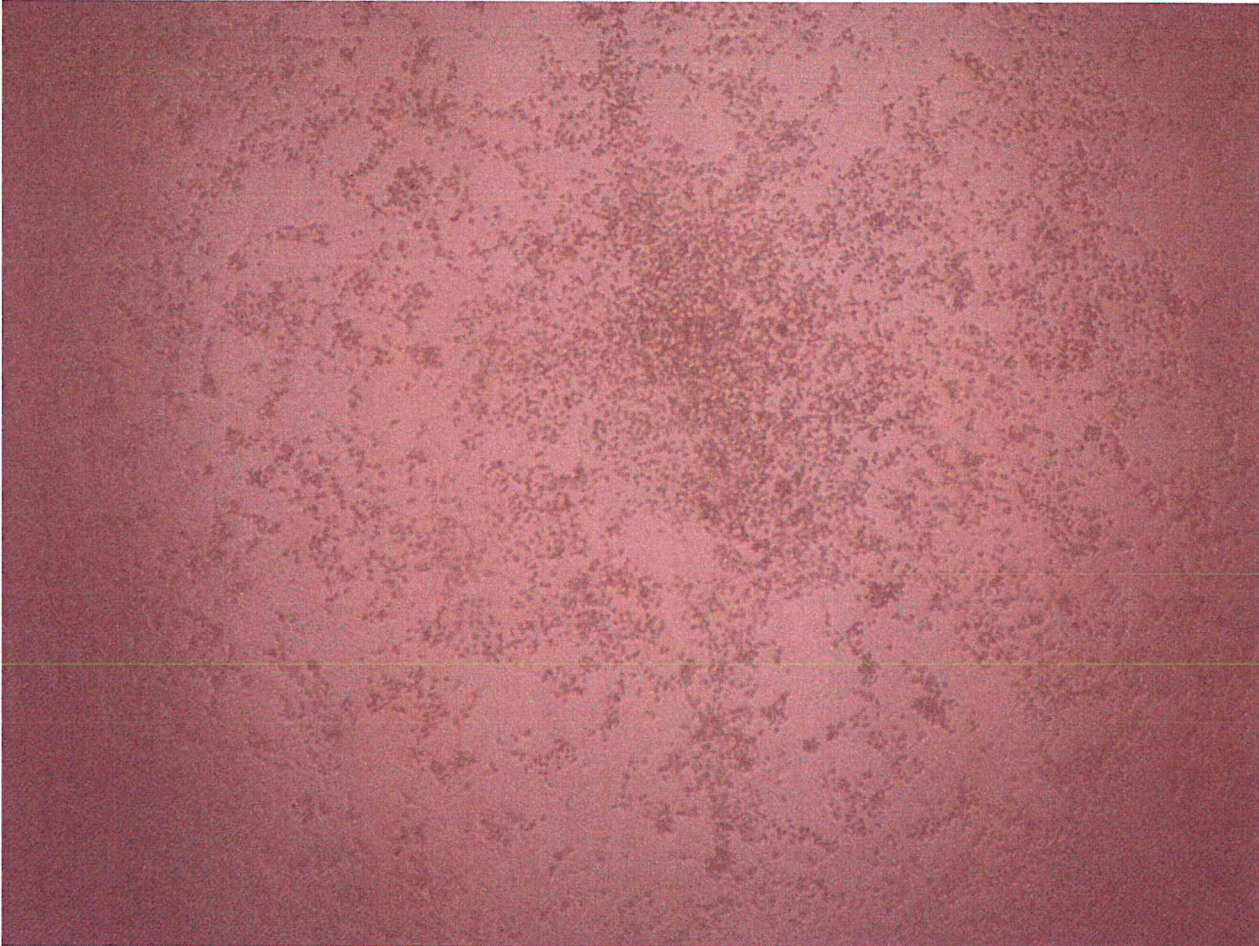

Plates of titration by TCID50/mL with Sars-Cov-2

Plate: cov-2-0

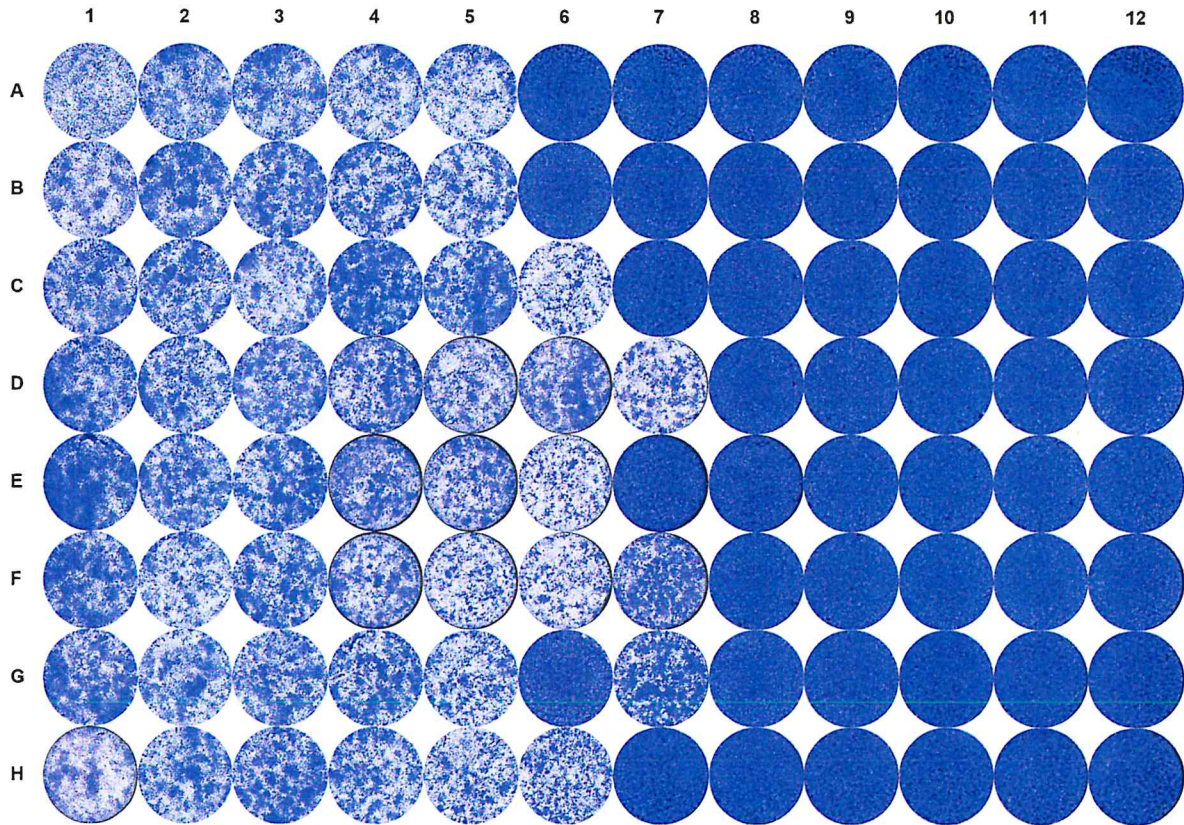

Cellular Technology Ltd, 2003-2016

CTL.



